

European Technical Assessment



Łukasiewicz
Instytut Ceramiki
i Materiałów
Budowlanych





Łukasiewicz
Instytut Ceramiki
i Materiałów
Budowlanych

31-983 Kraków,
POLAND
Cementowa Str. 8
Tel.: +48 12 683 79 00
info@icimb.pl
www.icimb.pl

Member of
EOTA
www.eota.eu

European Technical Assessment

ETA-16/0714
of 25/10/2021

General Part

Technical Assessment Body issuing the European Technical Assessment:
Łukasiewicz Research Network – Institute of Ceramics and Building Materials

Trade name of the construction product

BOLIX EXPRESS THERM

Product family to which the construction product belongs

04: External Thermal Insulation Composite Systems (ETICS) with renderings

Manufacturer

BOLIX SA
Stolarska 8
34-300 Żywiec, POLAND

Manufacturing plants

Stolarska 8
34-300 Żywiec, POLAND

This European Technical Assessment contains

32 pages including 4 Annexes which form an integral part of this assessment.

Annex No 5 Control Plan contains confidential information and is not included in the European Technical Assessment when that assessment is publicly disseminated.

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

EAD 040083-00-0404 ed. January 2019 – External Thermal Insulation Composite Systems (ETICS) with renderings

This European Technical Assessment replaces

ETA 16/0714, version 1, issued on 02/01/2017

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific part

1. Technical description of the product

This product BOLIX EXPRESS THERM is an External Thermal Insulation Composite System (ETICS) with renderings - a kit comprising components which are factory-produced by the manufacturer or component suppliers. The ETICS manufacturer is ultimately responsible for all components of the ETICS specified in this ETA.

The ETICS kit comprises a prefabricated insulation product of expanded polystyrene (EPS) to be bonded or mechanically fixed onto a wall. The method of fixing and the relevant components are specified in Table 1. The insulation product is faced with a rendering system consisting of one or more layers (site applied), one of which contains reinforcement. The rendering is applied directly to the insulating panels, without any air gap or disconnecting layer.

The ETICS may include special fittings (e.g. base profiles, corner profiles, expansion strips, tapes and sealing strips) to treat details of ETICS (connections, apertures, corners, parapets, sills) and reinforcement elements (e.g. prefabricated mesh elements). Assessment and performance of these components is not addressed in this ETA, however the ETICS manufacturer is responsible for adequate compatibility and performance within the ETICS when the components are delivered as a part of the kit.

Table 1.

Components	Coverage (kg/m ²)	Thickness (mm)
Bonded ETICS or bonded ETICS with supplementary mechanical fixings. National application documents shall be taken into account.		
<ul style="list-style-type: none"> • Insulation product: Boards of expanded polystyrene (EPS) according to EN 13163 <i>Product characteristics - see Annex No 1</i> 	-	50 to 500
<ul style="list-style-type: none"> • Adhesives: <ul style="list-style-type: none"> - BOLIX Z cement based powder requiring addition of 0,19-0,21 l/kg of water - BOLIX ALFA cement based powder requiring addition of 0,20-0,22 l/kg of water - BOLIX U cement based powder requiring addition of 0,20-0,22 l/kg of water - BOLIX UZ cement based powder requiring addition of 0,21-0,23 l/kg of water - BOLIX ZP ready to use polyurethane foam 	4,0 to 6,0 (powder)	-
<ul style="list-style-type: none"> • Supplementary mechanical fixings: Plastic anchors covered by relevant ETA 	-	-

Table 1. cont.

	Components	Coverage (kg/m ²)	Thickness (mm)
Mechanically fixed ETICS (through insulation product) with supplementary adhesive. National application documents shall be taken into account.			
Insulation materials with associated methods of fixing	<ul style="list-style-type: none"> Insulation product: Boards of expanded polystyrene (EPS) according to EN 13163 <i>Product characteristics - see Annex No 1</i> 	-	50 to 500
	<ul style="list-style-type: none"> Anchors <i>Products characteristics - see Annex No 2</i> 	-	-
	<ul style="list-style-type: none"> Supplementary adhesives: <ul style="list-style-type: none"> - BOLIX Z cement based powder requiring addition of 0,19-0,21 l/kg of water - BOLIX ALFA cement based powder requiring addition of 0,20-0,22 l/kg of water - BOLIX U cement based powder requiring addition of 0,20-0,22 l/kg of water - BOLIX UZ cement based powder requiring addition of 0,21-0,23 l/kg of water - BOLIX ZP ready to use polyurethane foam 	4,0 to 6,0 (powder) 4,0 to 6,0 (powder) 4,0 to 6,0 (powder) 4,0 to 6,0 (powder) about 90 ml/m ²	- - - - -
Base coat	<ul style="list-style-type: none"> BOLIX UBG cement based powder requiring addition of 0,20-0,22 l/kg of water 	about 4,0 or about 5,0* (powder)	3,0 to 5,0 or 4,0 to 6,0*
Reinforcement	<ul style="list-style-type: none"> Standard glass fibre meshes: applied in one or two layers <ul style="list-style-type: none"> - BOLIX HD 145/S - BOLIX HD 158/S - BOLIX HD 160/S - BOLIX HD 174/S <i>Products characteristics - see Annex No 4</i> 	- - - -	- - - -

*depending on number of layers of glass fibre meshes

Table 1. cont.

	Components	Coverage (kg/m ²)	Thickness (mm)
Key coats	<ul style="list-style-type: none"> BOLIX OP ready to use liquid to be used optionally with finishing coats BOLIX and obligatory with finishing coats BOLIX TM DECO, BOLIX BQB + BOLIX BQS BOLIX SIG kolor ready to use liquid to be used optionally with finishing coats BOLIX SIT / BOLIX SIT complex, BOLIX SI-SIT, BOLIX SIT / BOLIX SIT complex + BOLIX PW EXPRESS and BOLIX SI-SIT + BOLIX PW EXPRESS BOLIX T ready to use liquid to be used optionally with finishing coats BOLIX WS and BOLIX TBR and obligatory onto BOLIX WS and BOLIX TBR used with decorative coat BOLIX DECO LAZUR BOLIX SIG ready to use liquid to be used with decorative coats BOLIX SIL / BOLIX SIL Complex and BOLIX SIL-P 	0,25 to 0,40	-
		0,25 to 0,40	-
		0,10 to 0,20	-
		0,10 to 0,20	-
Finishing coats	<ul style="list-style-type: none"> Mineral finishing coats BOLIX WS cement based powder requiring addition of 0,19-0,21 l/kg of water modelled structure max. particles size: 0,5 mm BOLIX TBR cement based powder requiring addition of 0,18-0,22 l/kg of water modelled structure max. particles size: 0,8 mm 	4,5 to 15,0 (powder)	3,0 to 10,0
		4,5 to 15,0 (powder)	3,0 to 10,0
	<ul style="list-style-type: none"> Acrylic finishing coats BOLIX ready to use paste – acrylic binder floated structure max. particles size: 1,0; 1,5; 2,0 mm 	1,7 to 3,4	Regulated by particles size
	<ul style="list-style-type: none"> BOLIX TM DECO ready to use paste – acrylic binder spread structure max. particles size: 0,8 mm 	2,9 to 3,5	2,0 to 3,0

Table 1. cont.

	Components	Coverage (kg/m ²)	Thickness (mm)
Finishing coats	<ul style="list-style-type: none"> • Silicone finishing coat BOLIX SIT / BOLIX SIT complex ready to use paste – silicone and acrylic binder floated structure max. particles size: 1,0; 1,5; 2,0 mm • Silicone-silicate finishing coat BOLIX SI-SIT ready to use paste – silicate, silicone and acrylic binder floated structure max. particles size: 1,5; 2,0 mm • Polymer finishing coat - BOLIX BQB ready to use paste on polymer binder used with synthetic mineral briquettes BOLIX BQS synthetic mineral briquettes 	1,7 do 3,4 2,2 do 3,4 2,4 to 3,2 4,0 to 5,0	Regulated by particles size 1,5 to 2,5 3,0 to 6,0
Decorative coats	<ul style="list-style-type: none"> • BOLIX DECO LAZUR ready to use pigmented liquid to be used obligatory with finishing coat BOLIX WS and BOLIX TBR • BOLIX OM ready to use pigmented liquid to be used optionally onto decorative coat BOLIX DECO LAZUR • BOLIX SIL / BOLIX SIL Complex ready to use pigmented liquid to be used optionally with finishing coats BOLIX SIT/ BOLIX SIT Complex and BOLIX SI-SIT • BOLIX SIL-P ready to use pigmented liquid to be used optionally with finishing coats, BOLIX SIT/ BOLIX SIT Complex and BOLIX SI-SIT 	0,18 to 0,28 0,10 to 0,30 0,27 to 0,42 0,27 to 0,42	- - -
Ancillary materials	<ul style="list-style-type: none"> • Setting accelerator BOLIX PW-S EXPRESS, ready to use powder to be used optionally with adhesive BOLIX U; coverage: 10 g/kg of adhesive • Setting accelerator BOLIX PW EXPRESS, ready to use liquid to be used optionally with finishing coats BOLIX SIT/ BOLIX SIT Complex and BOLIX SI-SIT, coverage: 7 ml/kg of finishing coat • Other according to EAD 040083-00-0404 <p style="text-align: right;">Remain under the manufacturer's responsibilities</p>		

2. Specification of the intended use in accordance with the applicable European Assessment Document (hereinafter EAD)

This ETICS is intended to be used on new or existing (retrofit) vertical building walls. The ETICS may also be used on horizontal or inclined surfaces which are not exposed to precipitation.

The ETICS gives the building wall to which it is applied additional thermal insulation and protection from effects of weathering. ETICS are non-load-bearing construction elements. They do not contribute directly to the stability of the building wall on which they are installed.

ETICS are not intended to ensure the air tightness of the building structure.

Concerning product packaging, transport and storage it is the responsibility of the manufacturer to undertake the appropriate measures and to advise his clients on the transport and storage, as he considers necessary in order to reach the declared performances.

The information about installation is provided with the technical documentation from the Manufacturer and it is assumed that the product will be installed according to it or (in absence of such instructions) according to the usual practice of the building professionals.

The performances assessed in this European Technical Assessment, according to the applicable EAD, are based on an assumed intended working life of at least 25 years, provided that the conditions for the packaging, transport, storage, installation as well as appropriate use, maintenance and repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

The ETICS belongs to Category S/W2 according to EOTA Technical Report No 034.

3. Performance of the product and references to the methods used for its assessment

The tests for performance assessment of BOLIX EXPRESS THERM were carried out in compliance with EAD 040083-00-0404 according to the test methods reported herein, as well for what concerns sampling, conditioning and testing provisions. The performances of the kit as described in this chapter are valid provided that the components of the kit comply with Section 1 of the ETA and the relative Annexes 1 ÷ 4. The numbering in the following tables corresponds to the numbering of Table 1 of EAD 040083-00-0404.

3.1. Safety in case of fire (BWR 2)

3.1.1. Reaction to fire (EAD 040083-00-0404: clause 2.2.1, EN 13501-1)

3.1.1.1. Reaction to fire of ETICS (EAD 040083-00-0404: clause 2.2.1.1)

Table 2.

Configuration	Max. heat of combustion [MJ/kg]	Flame retardant content	Class acc. to EN 13501-1
Adhesive*	24,95	No flame retardant	B-s2, d0
EPS boards density ≤ 24,0 kg/m ³	-		
Base coat	0,69		
Glass fibre mesh (double layer)	2 x 8,61		
Key coat	31,95		
Finishing coat	3,33		
Key coat	26,55		
Decorative coat	26,36		

3.1.1.2. Reaction to fire of the thermal insulation material (EAD 040083-00-0404: clause 2.2.1.2)

See Annex No 1

3.1.1.3. Reaction to fire of PU foam adhesive (EAD 040083-00-0404: clause 2.2.1.3)

Table 3.

PU foam adhesive	Reaction to fire class acc. to EN 13501-1
BOLIX ZP	F

3.1.2. Façade fire performance (EAD 040083-00-0404: clause 2.2.2)

No performance assessed

3.1.3. Propensity to undergo continuous smouldering of ETICS (EAD 040083-00-0404: clause 2.2.3)

No performance assessed

3.2. Hygiene, health and environment (BWR 3)

3.2.1. Content, emission and/or release of dangerous substances – leachable substances (EAD 040083-00-0404: clause 2.2.4, EOTA TR034)

No performance assessed.

Note: There may be requirements applicable to the ETICS falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Regulation (EU) No 305/2011, these requirements need to be complied with, when and where they apply.

3.2.2. Water absorption (EAD 040083-00-0404: clause 2.2.5)

3.2.2.1. Water absorption of the base coat and the rendering system (EAD 040083-00-0404: clause 2.2.5.1)

• Base coat BOLIX UBG:

- Water absorption after 1 hour = 0,01 kg/m²;
- Water absorption after 24 hours = 0,12 kg/m².

• Rendering systems: Table 4.

Table 4.

Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat</u> indicated hereafter + key coat (if used) + decorative coat (if used):	Water absorption after 1 hour	Water absorption after 24 hours
	mean value (kg/m ²)	
<u>BOLIX WS + BOLIX T + BOLIX DECO LAZUR</u>	0,00	0,30
<u>BOLIX TBR + BOLIX T + BOLIX DECO LAZUR</u>	0,10	0,30
<u>BOLIX</u>	0,10	0,30
<u>BOLIX OP + BOLIX TM DECO</u>	0,10	0,40
<u>BOLIX SIT / BOLIX SIT Complex</u>	0,03	0,23
<u>BOLIX SIT / BOLIX SIT Complex + BOLIX PW EXPRESS</u>	0,03	0,21
<u>BOLIX SI-SIT</u>	0,03	0,23
<u>BOLIX SI-SIT + BOLIX PW EXPRESS</u>	0,01	0,15
<u>BOLIX OP + BOLIX BQB + BOLIX BQS</u>	0,00	0,40

3.2.2.2. Water absorption of the thermal insulation product (EAD 040083-00-0404: clause 2.2.5.2)

See Annex No 1

3.2.3. Water-tightness of the ETICS: Hygrothermal behaviour (EAD 040083-00-0404: clause 2.2.6)

Hygrothermal cycles have been performed on a rig in hygrothermal chamber. None of the following defects occurred during the testing:

- blistering or peeling of any finishing coat,
- failure or cracking associated with joints between insulation product boards,
- detachment of render,
- cracking allowing water penetration to the insulation layer.

The ETICS is so assessed resistant to hygrothermal cycles.

3.2.4. Water-tightness: Freeze-thaw performance (EAD 040083-00-0404: clause 2.2.7)

Water absorption of both, base coat and the rendering systems after 24 hours was lower than 0,5 kg/m² (Tab. 4).

The ETICS is so assessed as freeze-thaw resistant.

3.2.5. Impact resistance tested on the rig (EAD 040083-00-0404: clause 2.2.8)

Table 5.

		Hard body impact		
		Impact energy 3 J	Impact energy 10 J	Impact resistance category
Single layer of standard mesh BOLIX HD 145/S (AKE 145)		Impact diameter (mm) / damages		
Rig 1				
Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat indicated</u> hereafter + key coat (if used) + decorative coat (if used):	<u>BOLIX SIT /</u> <u>BOLIX SIT complex,</u> floated 1,0 mm	18 / superficial damages without cracks formation	38 / cracks without reaching the thermal insulation product	II
	<u>BOLIX SIT /</u> <u>BOLIX SIT complex,</u> floated 1,0 mm + BOLIX PW EXPRESS	17 / superficial damages without cracks formation	37 / cracks without reaching the thermal insulation product	II
	<u>BOLIX SI-SIT,</u> floated 1,5 mm	10 / superficial damages without cracks formation	33 / cracks without reaching the thermal insulation product	II
	<u>BOLIX SI-SIT,</u> floated 1,5 mm + BOLIX PW EXPRESS	14 / superficial damages without cracks formation	32 / cracks without reaching the thermal insulation product	II

Table 5 cont.

		Hard body impact		
		Impact energy 3 J	Impact energy 10 J	Impact resistance category
Single layer of standard mesh BOLIX HD 145/S (AKE 145)		Impact diameter (mm) / damages		
Rig 2				
Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat</u> indicated hereafter + key coat (if used) + decorative coat (if used):	<u>BOLIX WS</u> 3,0 mm + BOLIX T + BOLIX DECO LAZUR	8 / superficial damages without cracks formation	31 / cracks without reaching the thermal insulation product	II
	<u>BOLIX TBR</u> 3,0 mm + BOLIX T + BOLIX DECO LAZUR	19 / superficial damages without cracks formation	25 / cracks without reaching the thermal insulation product	II
	BOLIX OP + <u>BOLIX TM DECO</u> 2,0 mm	18 / superficial damages without cracks formation	31 / cracks without reaching the thermal insulation product	II
	BOLIX OP + <u>BOLIX BQB</u> 1,5 mm + <u>BOLIX BQS</u> 3,0 mm	0 / no damages	0 / no damages	I

3.2.6. Impact resistance not tested on the rig (EAD 040083-00-0404: clause 2.2.8)

Table 6.

		Hard body impact		
		Impact energy 3 J	Impact energy 10 J	Impact resistance category
Single layer of standard mesh BOLIX HD 145/S (AKE 145)		Impact diameter (mm) / damages		
Rig 2				
Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat</u> indicated hereafter + key coat (if used) + decorative coat (if used):	<u>BOLIX</u> , floated 1,0 mm	9 / superficial damages without cracks formation	21 / cracks without reaching the thermal insulation product	II

Table 7.

		Hard body impact		
		Impact energy 3 J	Impact energy 10 J	Impact resistance category
Double layer of standard mesh BOLIX HD 145/S (AKE 145)		Impact diameter (mm) / damages		
Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat</u> indicated hereafter + key coat (if used) + decorative coat (if used):	<u>BOLIX</u> , floated 1,0 mm	0 / no damages	0 / no damages	I
	<u>BOLIX OP + BOLIX TM DECO</u> 2,0 mm	7 / superficial damages without cracks formation	17 / superficial damages without cracks formation	I
	<u>BOLIX SIT / BOLIX SIT complex</u> , floated 1,0 mm	18 / superficial damages without cracks formation	38 / cracks without reaching the thermal insulation product	II
	<u>BOLIX SIT / BOLIX SIT complex</u> , floated 1,0 mm + BOLIX PW EXPRESS	17 / superficial damages without cracks formation	37 / cracks without reaching the thermal insulation product	II
	<u>BOLIX SI-SIT</u> , floated 1,5 mm	10 / superficial damages without cracks formation	33 / cracks without reaching the thermal insulation product	II
	<u>BOLIX SI-SIT</u> , floated 1,5 mm + BOLIX PW EXPRESS	14 / superficial damages without cracks formation	32 / cracks without reaching the thermal insulation product	II
	<u>BOLIX WS</u> 3,0 mm + BOLIX T + BOLIX DECO LAZUR	10 / superficial damages without cracks formation	18 / superficial damages without cracks formation	I
	<u>BOLIX TBR</u> 3,0 mm + BOLIX T + BOLIX DECO LAZUR	0 / no damages	0 / no damages	I
	<u>BOLIX OP + BOLIX BQB</u> 1,5 mm + <u>BOLIX BQS</u> 3,0 mm	0 / no damages	0 / no damages	I

3.2.7. Water vapour permeability (EAD 040083-00-0404: clause 2.2.9)

3.2.7.1. Water vapour permeability of the rendering system (equivalent air thickness s_d) (EAD 040083-00-0404: clause 2.2.9.1)

Table 8.

	Equivalent air thickness s_d (m)
BOLIX T + <u>BOLIX WS</u> + BOLIX T + BOLIX DECO LAZUR + BOLIX OM <i>thickness of rendering: 15,0 mm</i>	0,3
BOLIX T + <u>BOLIX TBR</u> + BOLIX T + BOLIX DECO LAZUR + BOLIX OM <i>thickness of rendering: 15,0 mm</i>	0,7
BOLIX OP + <u>BOLIX</u> <i>thickness of rendering: 7,0 mm</i>	0,3
BOLIX OP + <u>BOLIX TM DECO</u> <i>thickness of rendering: 8,0 mm</i>	0,5
Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + finishing coat indicated hereafter + key coat (if used) + decorative coat (if used):	
BOLIX SIG kolor + <u>BOLIX SIT / BOLIX SIT</u> <u>complex</u> + BOLIX SIG + BOLIX SIL / BOLIX SIL Complex <i>thickness of rendering: 7,0 mm</i>	0,3
BOLIX SIG kolor + <u>BOLIX SIT / BOLIX SIT</u> <u>complex</u> + BOLIX SIG + BOLIX SIL-P <i>thickness of rendering: 7,0 mm</i>	0,2
BOLIX SIG kolor + <u>BOLIX SIT / BOLIX SIT</u> <u>complex</u> + BOLIX PW EXPRESS <i>thickness of rendering: 7,0 mm</i>	0,2
BOLIX SIG kolor + <u>BOLIX SI-SIT</u> + BOLIX SIG + BOLIX SIL / BOLIX SIL Complex <i>thickness of rendering: 7,0 mm</i>	0,3
BOLIX SIG kolor + <u>BOLIX SI-SIT</u> + BOLIX SIG + BOLIX SIL-P <i>thickness of rendering: 8,0 mm</i>	0,3
BOLIX SIG kolor + <u>BOLIX SI-SIT</u> + BOLIX PW EXPRESS <i>thickness of rendering: 7,0 mm</i>	0,3
BOLIX OP + <u>BOLIX BQB + BOLIX BQS</u> <i>thickness of rendering: 13,5 mm</i>	0,4

3.2.7.2. Water vapour permeability of the thermal insulation product (water-vapour resistance factor) (EAD 040083-00-0404: clause 2.2.9.2)

See Annex No 1

3.3. Safety in use (BWR 4)

3.3.1. Bond strength (EAD 040083-00-0404: clause 2.2.11)

3.3.1.1. Bond strength between the base coat and the thermal insulation product (EAD 040083-00-0404: clause 2.2.11.1)

Table 9.

		Bond strength (kPa)	
		mean	min
BOLIX UBG	initial state	134*	110
	hygrothermal cycles (from the rig)	104*	99
	freeze-thaw cycles	test not required	

*cohesive rupture in insulation

3.3.1.2. Bond strength between the adhesive and the substrate (EAD 040083-00-0404: clause 2.2.11.2)

Table 10.

		Bond strength (kPa)	
		mean	min
BOLIX Z** minimal bonded surface area S: 26%	initial state	880*	840
	48 h immersion in water + 2 hours 23°C/50% RH	748*	700
	48 h immersion in water + 7 days 23°C/50% RH	926*	900
BOLIX ALFA** minimal bonded surface area S: 26%	initial state	954*	930
	48 h immersion in water + 2 hours 23°C/50% RH	834*	800
	48 h immersion in water + 7 days 23°C/50% RH	1160*	1100
BOLIX U** minimal bonded surface area S: 25%	initial state	912*	870
	48 h immersion in water + 2 hours 23°C/50% RH	792*	770
	48 h immersion in water + 7 days 23°C/50% RH	1126*	1100
BOLIX UZ** minimal bonded surface area S: 25%	initial state	800*	740
	48 h immersion in water + 2 hours 23°C/50% RH	762*	720
	48 h immersion in water + 7 days 23°C/50% RH	1178*	1120

*adhesive rupture; **thickness of adhesive – about 3 mm

3.3.1.3. Bond strength between the adhesive and the thermal insulation product (EAD 040083-00-0404: clause 2.2.11.3)

Table 11.

		Bond strength (kPa)	
		mean	min
BOLIX Z** minimal bonded surface area S: 26%	initial state	120*	116
	48 h immersion in water + 2 hours 23°C/50% RH	115*	110
	48 h immersion in water + 7 days 23°C/50% RH	121*	117
BOLIX ALFA** minimal bonded surface area S: 26%	initial state	121*	117
	48 h immersion in water + 2 hours 23°C/50% RH	114*	112
	48 h immersion in water + 7 days 23°C/50% RH	124*	121
BOLIX U** minimal bonded surface area S: 25%	initial state	124*	121
	48 h immersion in water + 2 hours 23°C/50% RH	118*	115
	48 h immersion in water + 7 days 23°C/50% RH	126*	124
BOLIX UZ** minimal bonded surface area S: 25%	initial state	123*	119
	48 h immersion in water + 2 hours 23°C/50% RH	115*	112
	48 h immersion in water + 7 days 23°C/50% RH	125*	123

*cohesive rupture in insulation; ** thickness of adhesive – about 3 mm

3.3.1.4. Bond strength of foam adhesive (EAD 040083-00-0404: clause 2.2.11.4)

Table 12.

		Bond strength (kPa)		
		mean	min.	number of test results in range 60-80
BOLIX ZP	standard application conditions	124*	109	0
	modification of foam thickness (15 mm)	80*	74	1
	modification of open time (3 minutes)	121*	110	0
	modification of temperature (0 °C)	91*	84	0
	modification of temperature (35 °C)	80*	77	1

*cohesive rupture in foam

3.3.2. Fixing strength (transverse displacement test) (EAD 040083-00-0404: clause 2.2.12)

Test not required because the ETICS fulfils the following criteria: $E \cdot d < 50\ 000 \text{ N/mm}$.

3.3.3. Wind load resistance of ETICS (EAD 040083-00-0404: clause 2.2.13)

3.3.3.1. Pull-through test of fixings (EAD 040083-00-0404: clause 2.2.13.1)

Table 13.

Anchors for which the following failure loads apply		Anchors according to Annex No 2	
		Plate diameter (mm)	≥ 60
Characteristics of the EPS boards for which the following failure loads apply		Thickness (mm)	≥ 50
		Tensile strength perpendicular to the faces under dry condition (kPa)	≥ 144
Failure loads (kN)	Anchors not placed at the panel joints (<i>Pull-through test</i>) dry conditions	R_{panel}	individual values: 0,446; 0,442; 0,445; 0,509; 0,453 mean: 0,459
	Anchors placed at the panel joints (<i>Pull-through test</i>) dry conditions		individual values: 0,428; 0,423; 0,450; 0,502; 0,440 mean: 0,449

Load / Displacement Graphs see Annex No 3.

3.3.3.2. Static foam block test (EAD 040083-00-0404: clause 2.2.13.2)

Not relevant

3.3.3.3. Dynamic wind uplift test (EAD 040083-00-0404: clause 2.2.13.3)

Not relevant

3.3.4. Tensile test perpendicular to the faces of thermal insulation product (EAD 040083-00-0404: clause 2.2.14)

See Annex No 1

3.3.5. Shear strength and shear modulus of elasticity test of ETICS (EAD 040083-00-0404: clause 2.2.15)

See Annex No 1

3.3.6. Render strip tensile test (EAD 040083-00-0404: clause 2.2.17)

No performance assessed

3.3.7. Shear strength and shear modulus of foam adhesive (EAD 040083-00-0404: clause 2.2.18)

Table 14.

	Shear strength (kPa)		Shear modulus (MPa)	
	mean	min.	mean	min.
BOLIX ZP	78,4	75,2	0,525	0,466

3.3.8. Post expansion behaviour of foam adhesive (EAD 040083-00-0404: clause 2.2.19)

Table 15.

	Expansion (mm) after -initial thickness 8 mm-		
	time	mean	max
BOLIX ZP	5 min.	0,80	0,88
	10 min.	0,46	0,67
	20 min.	0,14	0,22
	40 min.	0,12	0,30
	60 min.	0,17	0,37
	24 hours	0,26	0,40

3.3.9. Bond strength after ageing (EAD 040083-00-0404: clause 2.2.20)

3.3.9.1. Bond strength after ageing of finishing coat tested on the rig (EAD 040083-00-0404: clause 2.2.20.1)

Table 16.

	Bond strength after hygrothermal cycles (kN/m ²)	
	mean	individual values
Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat</u> indicated hereafter + key coat (if used) + decorative coat (if used):	<u>BOLIX WS + BOLIX T + BOLIX DECO LAZUR</u>	112* 101; 122; 113; 105; 117
	<u>BOLIX TBR + BOLIX T + BOLIX DECO LAZUR</u>	107* 112; 105; 116; 99; 101
	<u>BOLIX OP + BOLIX TM DECO</u>	110* 97; 111; 121; 122; 104
	<u>BOLIX SIT / BOLIX SIT complex</u>	142* 142; 123; 171; 134; 138
	<u>BOLIX SIT / BOLIX SIT complex + BOLIX PW EXPRESS</u>	145* 115; 152; 159; 152; 146
	<u>BOLIX SI-SIT</u>	155* 190; 153; 167; 106; 160
	<u>BOLIX SI-SIT + BOLIX PW EXPRESS</u>	186* 191; 192; 203; 184; 162
	<u>BOLIX OP + BOLIX BQB + BOLIX BQS</u>	110* 121; 112; 107; 112; 98

*cohesive rupture in insulation

3.3.9.2. Bond strength after ageing of finishing coat not tested on the rig (EAD 040083-00-0404: clause 2.2.20.2)

Table 16.

Rendering system: Base coat: <u>BOLIX UBG</u> + relevant key coat + <u>finishing coat indicated</u> hereafter + key coat (if used) + decorative coat (if used):	<u>BOLIX</u>	Bond strength after hygrothermal cycles (kN/m²)	
		mean	individual values
		127*	130; 119; 127; 124; 133

3.3.10. Mechanical and physical characteristics of the mesh (EAD 040083-00-0404: clause 2.2.21)

3.3.10.1. Tensile strength and elongation of the glass fibre mesh in the as-delivered (EAD 040083-00-0404: clause 2.2.21.1)

Table 17.

	Average tensile strength in the as-delivered state (N/mm)		Average elongation in the as-delivered state (%)	
	warp	weft	warp	weft
BOLIX HD 145/S (AKE 145)	45,7	39,3	4,81	4,74
BOLIX HD 145/S (R 117 A101)	45,0	47,0	3,70	4,20
BOLIX HD 145/S (SSA-1363-145)	49,0	50,0	3,80	3,70
BOLIX HD 158/S (ST 2924-100/7 KM)	50,1	34,0	3,80	3,30
BOLIX HD 158/S (R 131 A101)	48,0	50,0	3,90	4,00
BOLIX HD 160/S (03-1)	41,3	46,7	4,24	5,03
BOLIX HD 160/S (SSA-1363-160)	43,0	45,0	3,60	3,90
BOLIX HD 174/S (ST 112-100/7 KM)	56,8	44,1	4,50	3,80

3.3.10.2. Tensile strength and elongation of the glass fibre mesh after ageing state (EAD 040083-00-0404: clause 2.2.21.2)

Table 18.

	Average tensile strength after ageing (N/mm)		Residual strength after ageing (%)		Average elongation after ageing (%)	
	warp	weft	warp	weft	warp	weft
BOLIX HD 145/S (AKE 145)	24,8	20,8	54,3	52,9	2,39	2,74
BOLIX HD 145/S (R 117 A101)	23,0	28,0	51,1	59,6	2,10	2,40
BOLIX HD 145/S (SSA-1363-145)	25,0	29,0	51,0	58,0	2,10	2,30
BOLIX HD 158/S (ST 2924-100/7 KM)	29,6	21,5	59,1	63,2	2,30	1,80
BOLIX HD 158/S (R 131 A101)	33,0	38,0	68,7	76,0	2,90	3,00
BOLIX HD 160/S (03-1)	20,8	24,1	50,4	51,6	1,84	1,69
BOLIX HD 160/S (SSA-1363-160)	26,0	29,0	60,5	64,4	2,30	2,30
BOLIX HD 174/S (ST 112-100/7KM)	31,7	25,1	55,8	56,9	2,60	2,00

3.4. Protection against noise (BWR 5)

3.4.1. Airborne sound insulation of ETICS (EAD 040083-00-0404: clause 2.2.22)

3.4.1.1. Airborne sound insulation of ETICS (EAD 040083-00-0404: clause 2.2.22.1)

No performance assessed

3.4.1.2. Dynamic stiffness of the thermal insulation product (EAD 040083-00-0404: clause 2.2.22.2)

No performance assessed

3.4.1.3. Air flow resistance of the thermal insulation product (EAD 040083-00-0404: clause 2.2.22.3)

No performance assessed

3.5. Energy economy and heat retention (BWR 6)

3.5.1. Thermal resistance and thermal transmittance of ETICS (EAD 040083-00-0404: clause 2.2.23)

The additional thermal resistance provided by the ETICS (R_{ETICS}) to the substrate has been assessed by calculations on the basis of the thermal resistance of the thermal insulation product ($R_{insulation}$) and from either the tabulated (R_{render}) value of the render system [about 0,02 in (m²·K)/W].

$$R_{ETICS} = R_{insulation} + R_{render}$$

as described in EN ISO 10456.

Table 19.

Thermal resistance R_{ETICS} with minimum thickness of EPS* [(m ² ·K)/W]	Thermal resistance R_{ETICS} with maximum thickness of EPS* [(m ² ·K)/W]
1,21	11,94

*at maximum value of thermal conductivity 0,042 W/(m · K)

The thermal transmittance of the substrate wall covered by the ETICS is calculated in accordance with the standard EN ISO 6946:

$$U_c = U + \chi_p \cdot n$$

where:

$\chi_p \cdot n$ has only to be taken into account if it is greater than 0,04 W/(m²·K)

U_c : corrected thermal transmittance of the entire wall (W/(m²·K))

n : number of anchors (through insulation product) per 1 m²

χ_p : point thermal transmittance value of the anchor (W/K). The values listed below can be taken into account if not specified in the anchor's ETA:

= 0,002 W/K for anchors with a plastic screw/nail, stainless steel screw/nail with the head covered by at least 15 mm plastic material, or with a minimum 15 mm air gap at the head of the screw/nail;

= 0,004 W/K for anchors with a galvanized carbon steel screw/nail with the head covered by at least 15 mm plastic material, or with a minimum 15 mm air gap at the head of the screw/nail;

= 0,008 W/K for all other anchors (worst case);

U : thermal transmittance of the current part of the covered wall (excluding thermal bridges) (W/(m²·K)) determined as follows:

$$U = \frac{1}{R_{insulation} + R_{render} + R_{substrate} + R_{se} + R_{si}}$$

where:

$R_{insulation}$: thermal resistance of the insulation product (according to declaration in reference to EN 13163) in (m²·K)/W

R_{render} : thermal resistance of the render (about 0,02 in (m²·K)/W or determined by test according to EN 12667 or EN 12664)

$R_{substrate}$: thermal resistance of the substrate wall in (m²·K)/W

R_{se} : external surface thermal resistance in (m²·K)/W

R_{si} : internal surface thermal resistance in (m²·K)/W

The value of thermal resistance of each insulation product shall be given in the manufacturer's documentation along with the possible range of thicknesses. In addition, the point thermal conductivity of anchors shall be given when anchors are used in the ETICS.

3.5.2. Thermal resistance of the thermal insulation product (EAD 040083-00-0404: clause 2.2.23.1)

See Annex No 1

4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD No. 040083-00-0404, the applicable European legal act is: Decision 97/556/EC. The system(s) of assessment and verification of constancy of performance (AVCP) is 2+.

In addition, with regard to reaction to fire for products, the applicable European legal act is Decision 97/556/EC, as amended by Decision 2001/596/EC. The system of assessment and verification of constancy of performance (AVCP) is 2+.


5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

The manufacturer shall perform a permanent internal factory production control based on the Control Plan.

The Control Plan for the manufacturer is specified in clause 3.2 of EAD 040083-00-0404 *External Thermal Insulation Composite Systems (ETICS) with renderings*.

The manufacturer and Łukasiewicz Research Network – Institute of Ceramics and Building Materials TAB have agreed a Control Plan which is deposited at Łukasiewicz Research Network – Institute of Ceramics and Building Materials TAB in documentation which accompanies ETA.

Issued in Krakow on 25.10.2021

By

Paweł PICHNIARCZYK

Director of Łukasiewicz Research Network – Institute of Ceramics and Building Materials

Annexes:

Annex No 1 – Insulation products characteristics

Annex No 2 – Anchors characteristics

Annex No 3 – Load-displacement graphs

Annex No 4 – Glass fibre meshes characteristics

Annex No 1 – Insulation products characteristics

Boards of expanded polystyrene EPS white or grey		
	Bonded ETICS or bonded ETICS with supplementary mechanical fixings	Mechanically fixed ETICS with supplementary adhesive
Reaction to fire / EN 13501-1	Class E max. density: 24,0 kg/m ³	
Thermal resistance	Defined in the CE marking in reference to EN 13163 (m ² ·K)/W	
Thermal conductivity (λ_D) / EN 12667 / EN 12939	$\leq 0,042 \text{ W}/(\text{m} \cdot \text{K})$	
Thickness / EN 823	$\pm 2 \text{ mm}$ [EN 13163 – T(2)]	
Length / EN 822	$\pm 2 \text{ mm}$ [EN 13163 – L(2)]	
Width / EN 822	$\pm 2 \text{ mm}$ [EN 13163 – W(2)]	
Squareness / EN 824	$\pm 5 \text{ mm}/\text{m}$ [EN 13163 – S(5)]	
Flatness / EN 825	5 mm [EN 13163 – P(5)]	
Dimensional stability under specified conditions	EN 1603	$\pm 0,2 \%$ [EN 13163 – DS(N)2]
	EN 1604	2 % [EN 13163 – DS(70,-)2]
Bending strength / EN 12089	$\geq 75 \text{ kPa}$ [EN 13163 – BS75]	
Water vapour permeability, diffusion factor (μ) / EN 12086 - EN 13163	20 to 40	
Water absorption / EN 1609/Method A	$\leq 1,0 \text{ kg}/\text{m}^2$	
Tensile strength perpendicular to the EN 1607	$\geq 80 \text{ kPa}; \text{EPS-EN}$ 13163 - TR 80	$\geq 100 \text{ kPa}; \text{EPS-EN}$ 13163 - TR 100
Shear strength / EN 12090 – EN 13163	$\geq 20 \text{ kPa}$	
Shear modulus / EN 12090 – EN 13163	$\geq 1000 \text{ kPa}$	

Annex No 2 – Anchors characteristics


Anchor trade name	Plate stiffness (kN/mm) / diameter (mm)	Characteristic resistance in the substrate
EJOT H1 eco EJOT H4 eco	0,6 / 60	ETA 11/0192
Ejotherm STR U 2G	0,6 / 60	ETA 04/0023
Insulation anchor Koelner TFIX-8S, Koelner TFIX-8ST	0,6 / 60	ETA 11/0144
Insulation suport TFIIX-8M	1,0 / 60	ETA 07/0336
Rawlplug Facade Insulation Fixing R-TFIX-8M	1,0 / 60	ETA 17/0592
RAWLPLUG Insulation System R-TFIX-8S	0,6 / 60	ETA 17/0161
Koelner KI-10M Koelner KI-10	0,4 / 60 0,5 / 60	ETA-07/0291
KI-10N KI-10NS	0,5 / 60	ETA 07/0221
WKTHERMø8	0,6 / 60	ETA 11/0232
WKTHERM S	0,6 / 60	ETA 13/0724
fischer TERMOZ 8 U fischer TERMOZ 8 UZ	0,5 / 60	ETA-02/0019
fischer termoz CN 8 fischer termoz CN 8 R fischer termoz CNplus 8	0,6 / 60	ETA-09/0394
fischer termoz CS 8	0,6 / 60	ETA-14/0372
TERMOFIX CF 8	0,5 / 60	ETA-07/0287
eco-drive	0,6 / 60	ETA 13/0107

Additionally, other anchors covered by relevant ETA can be used, provided that they meet the following requirements:


Requirement	
Anchors* fixed through insulation product	
Plate diameter	≥ 60 mm
Plate stiffness	≥ 0,4 kN/mm

*anchors with pin made of steel shall be used


Annex No 3 – Load-displacement graphs

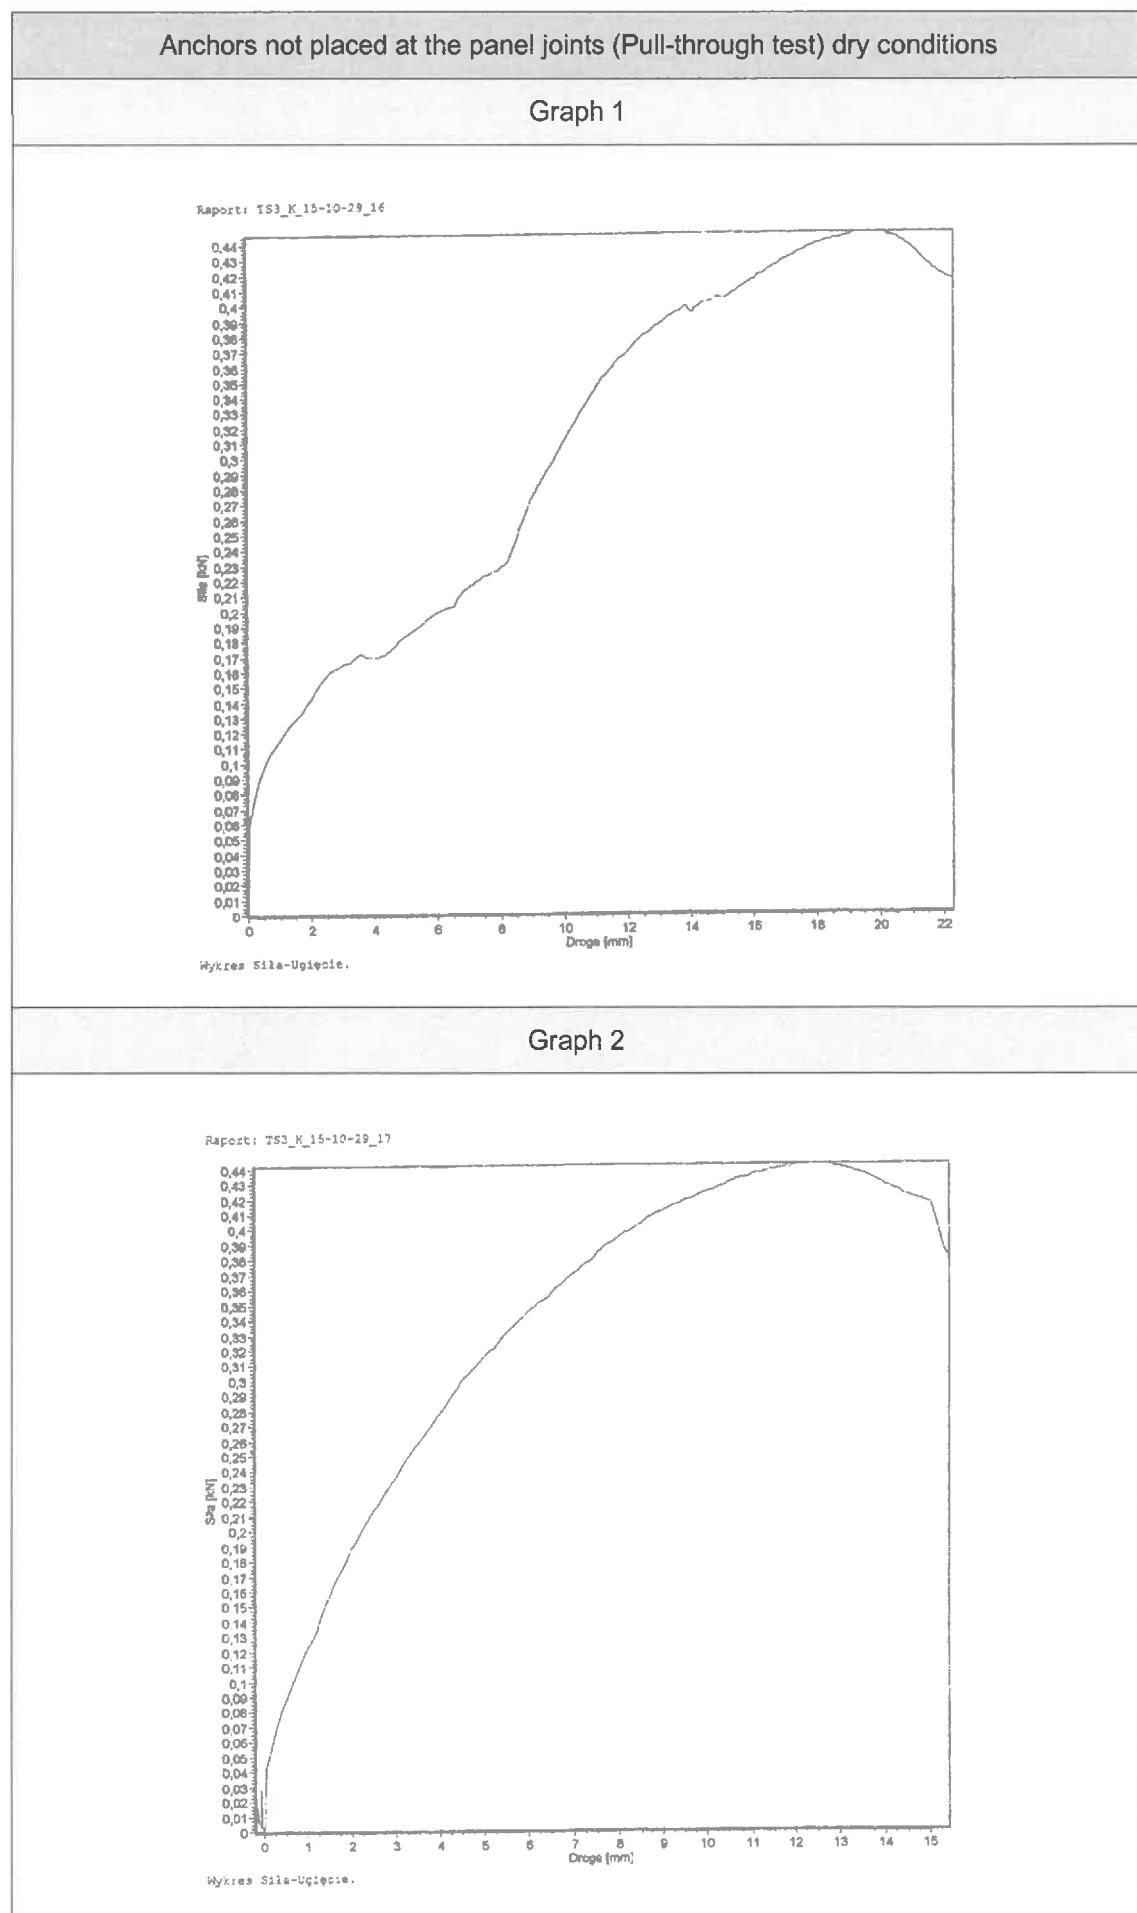

Annex No 3 – Load-displacement graphs cont.

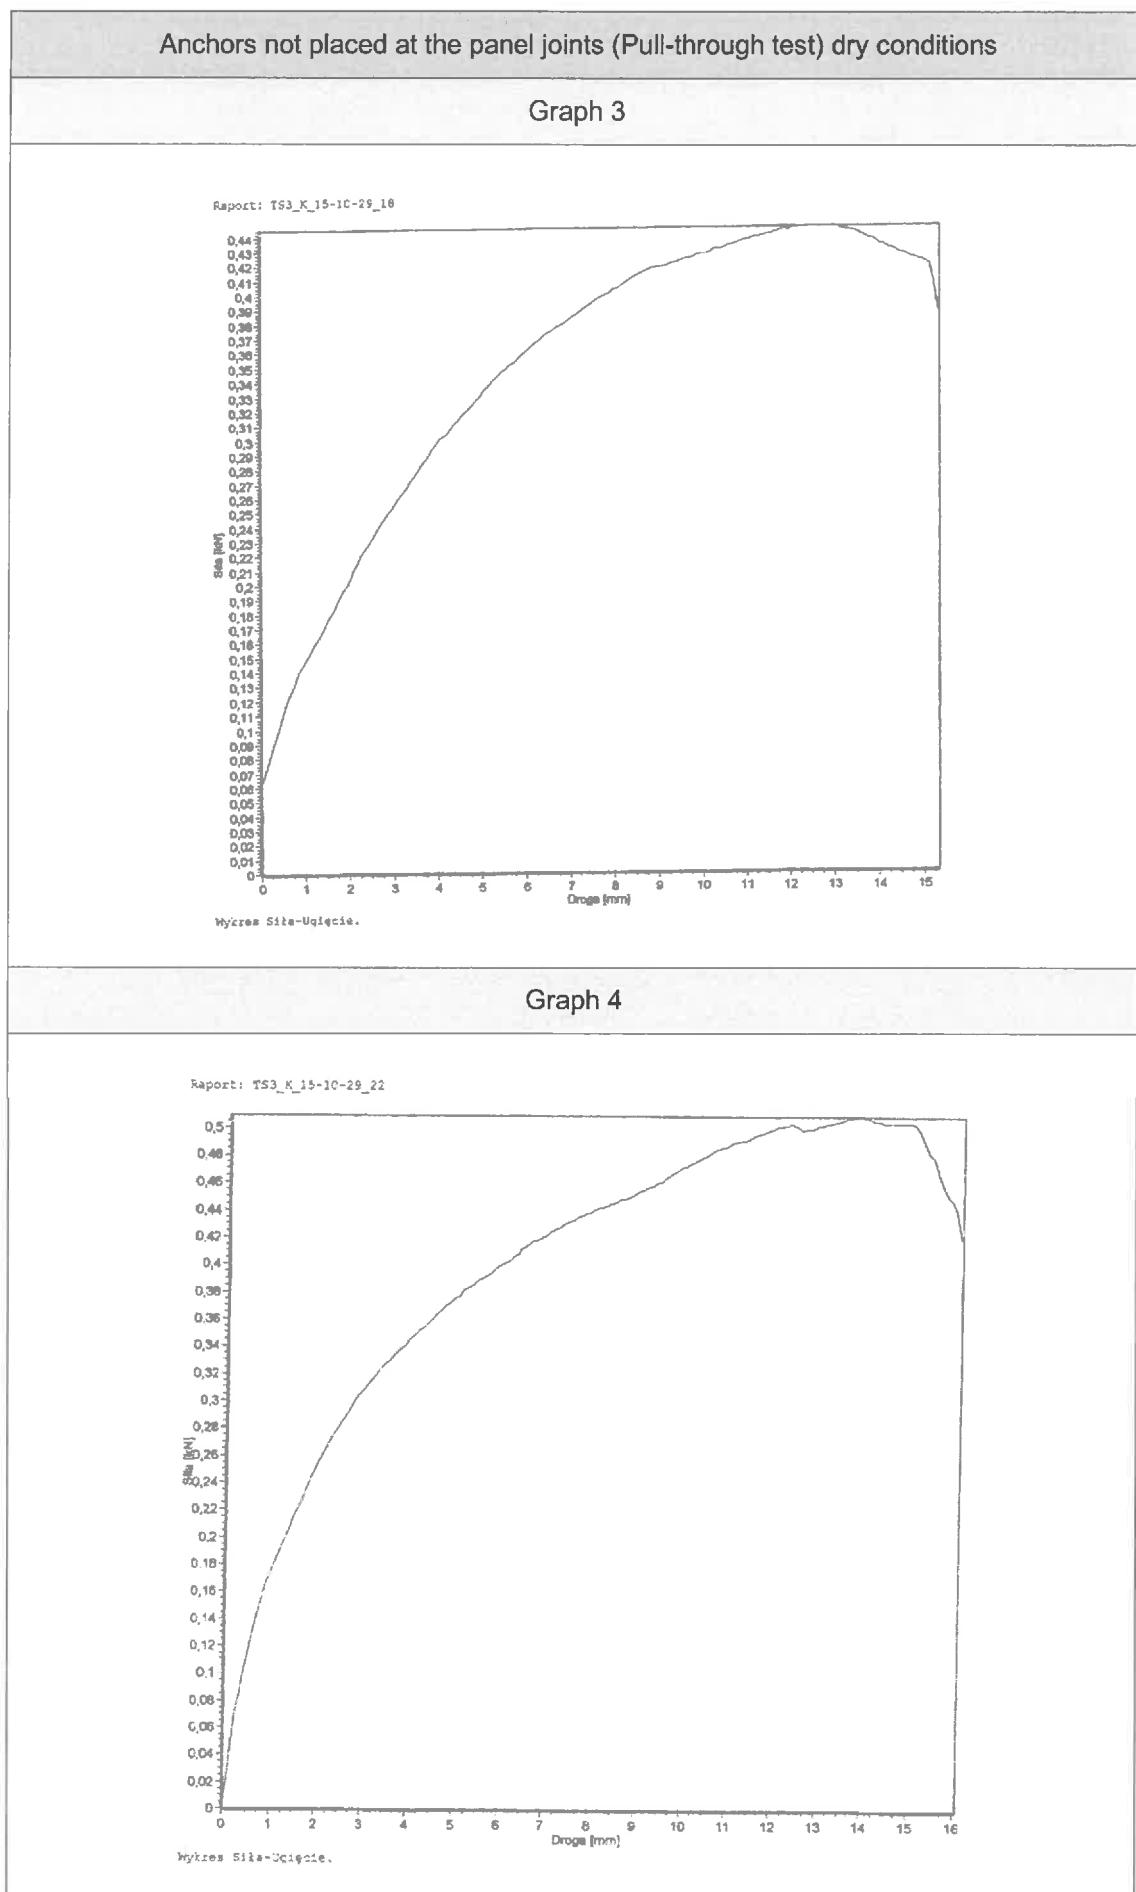

Annex No 3 – Load-displacement graphs cont.

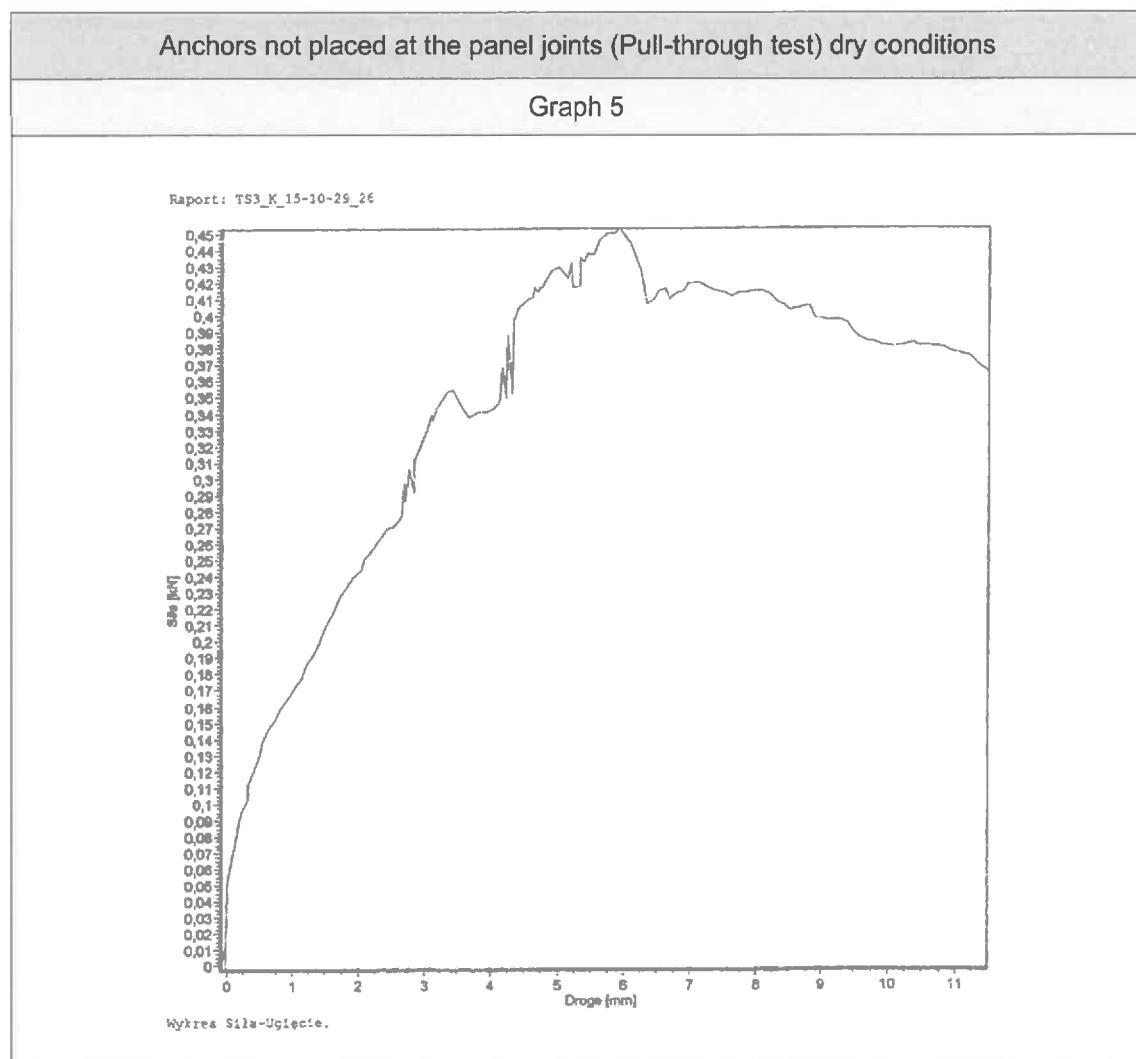


Annex No 3 – Load-displacement graphs cont.

Anchors placed at the panel joints (Pull-through test) dry conditions


Graph 1

Report: TS3_K_2015-10-29_9

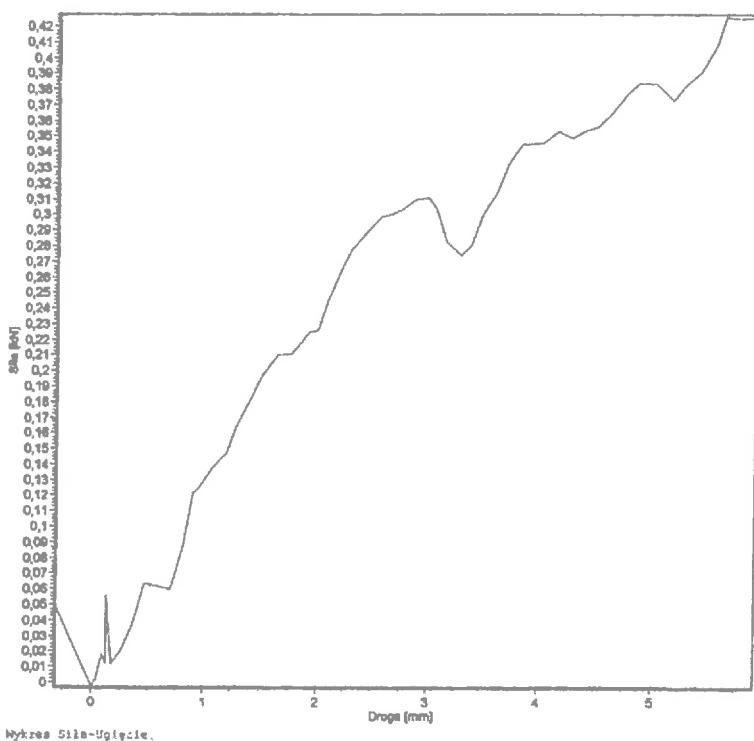

Graph 2


Report: TS3_K_2015-10-29_27

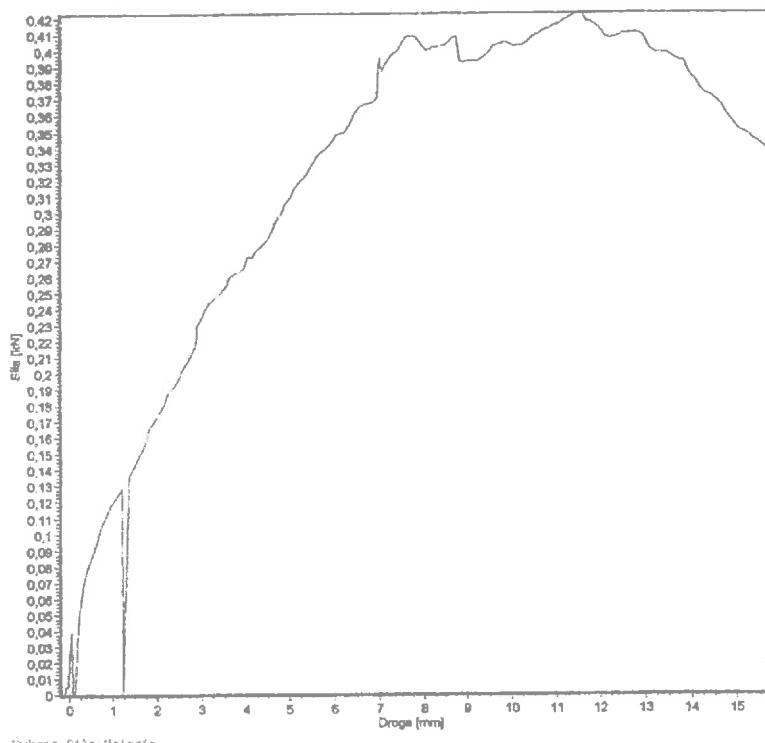

Annex No 3 – Load-displacement graphs cont.


Anchors placed at the panel joints (Pull-through test) dry conditions

Graph 3

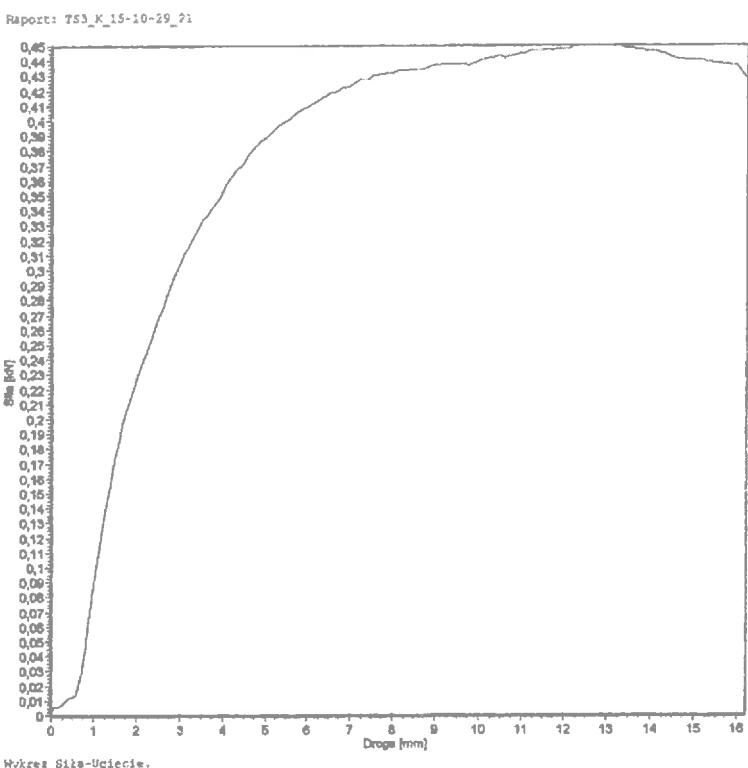


Graph 4

Report: TS3_K_15-10-29_19

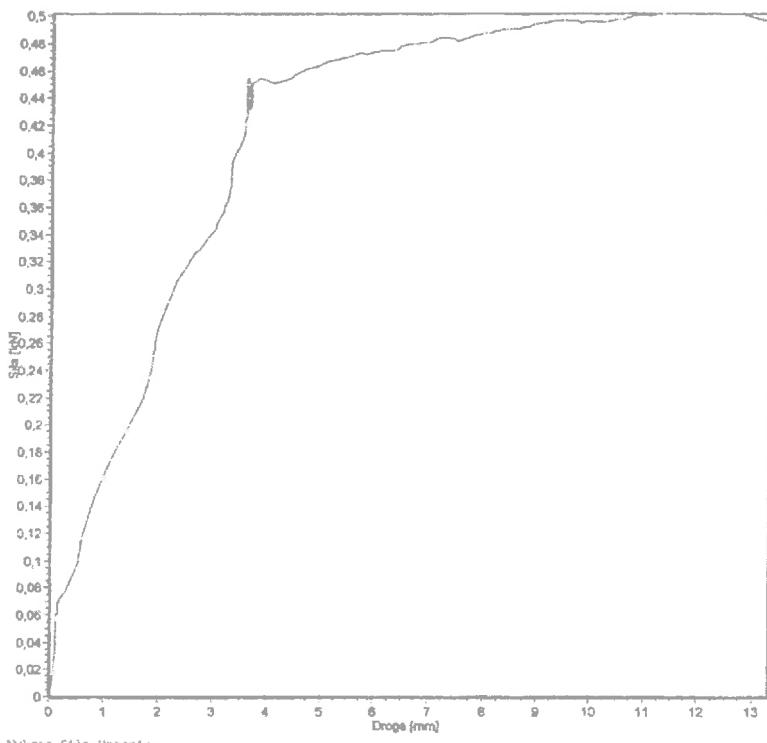

Annex No 3 – Load-displacement graphs cont.

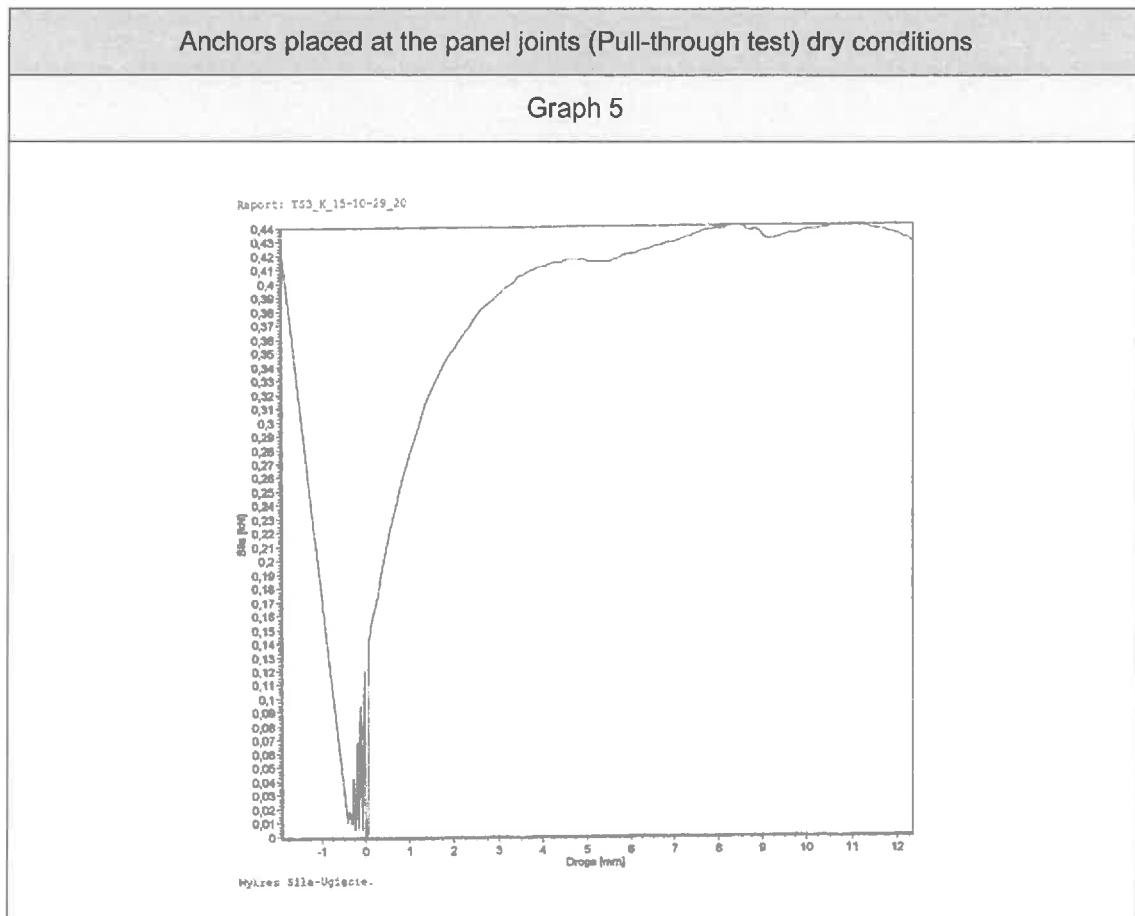

Annex No 4 – Glass fibre meshes characteristics

Mesh trade name		Description	Alkalies resistance	
			Residual resistance after ageing (N/mm)	Relative residual resistance: % (after ageing) of the strength in the as delivered state
BOLIX HD 145/S	AKE 145	Mass per unit area: 145 g/m ² Mesh size: 4,0 x 4,5 mm	≥ 20	≥ 50
	R 117 A101	Mass per unit area: 152 g/m ² Mesh size: 4,0 x 4,5 mm		
	SSA-1363-145	Mass per unit area: 151 g/m ² Mesh size: 4,5 x 3,8 mm		
BOLIX HD 158/S	ST 2924-100/7 KM	Mass per unit area: 145 g/m ² Mesh size: 4,0 x 3,7 mm	≥ 20	≥ 50
	R 131 A101	Mass per unit area: 167 g/m ² Mesh size: 4,0 x 4,6 mm	≥ 20	≥ 50
BOLIX HD 160/S	03-1	Mass per unit area: 156 g/m ² Mesh size: 4,0 x 3,7 mm	≥ 20	≥ 50
	SSA-1363-160	Mass per unit area: 165 g/m ² Mesh size: 4,0 x 3,9 mm		
BOLIX HD 174/S	ST 112-100/7KM	Mass per unit area: 165 g/m ² Mesh size: 3,3 x 3,6 mm	≥ 20	≥ 50

Sieć Badawcza Łukasiewicz
– Instytut Ceramiki i Materiałów Budowlanych
Oddział Szkła i Materiałów Budowlanych w Krakowie
ul. Cementowa 8, 31-983 Kraków

www.icimb.pl

